



# INSTALLATION OF ASME UNDERGROUND AND AG/UG TANKS

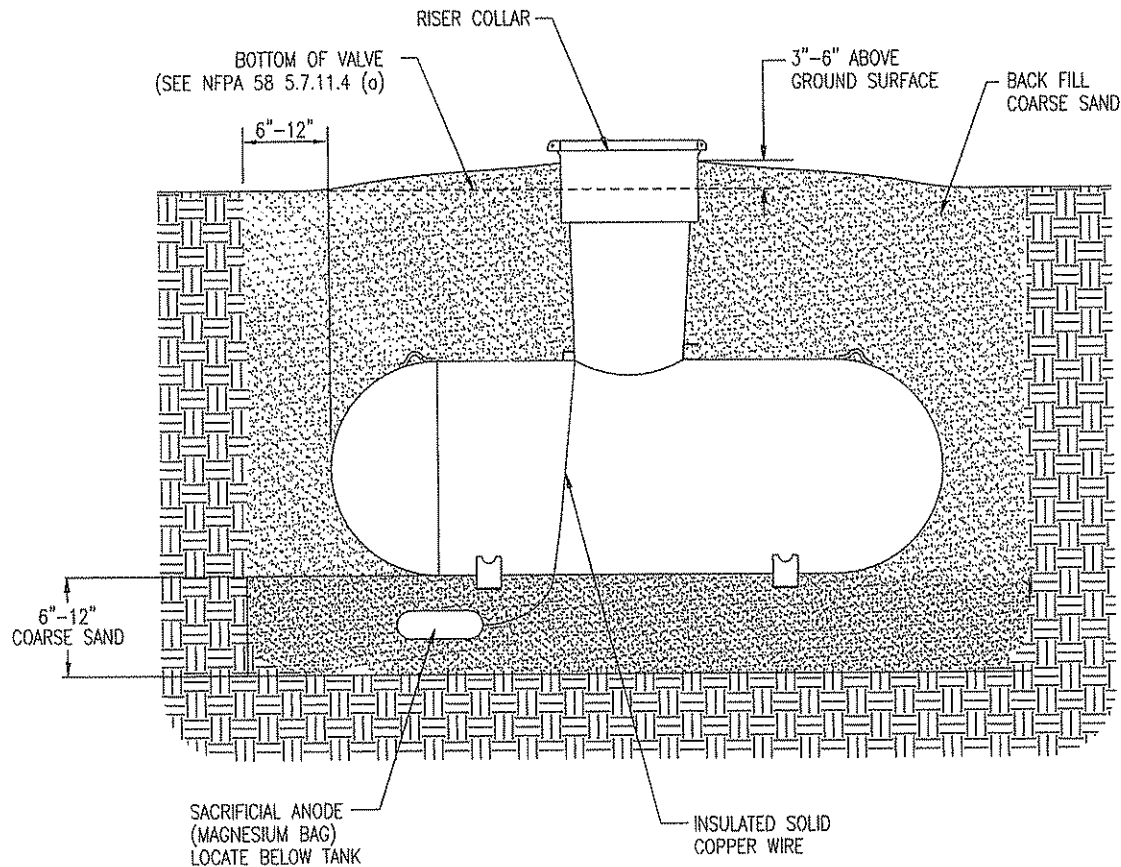

NOTE: MINIMUM BURIAL REQUIREMENTS BASED ON WIDTH AND LENGTH OF TANK WITH LONG RISER SHROUD AND MAXIMUM BACK FILL REQUIREMENTS EQUAL.

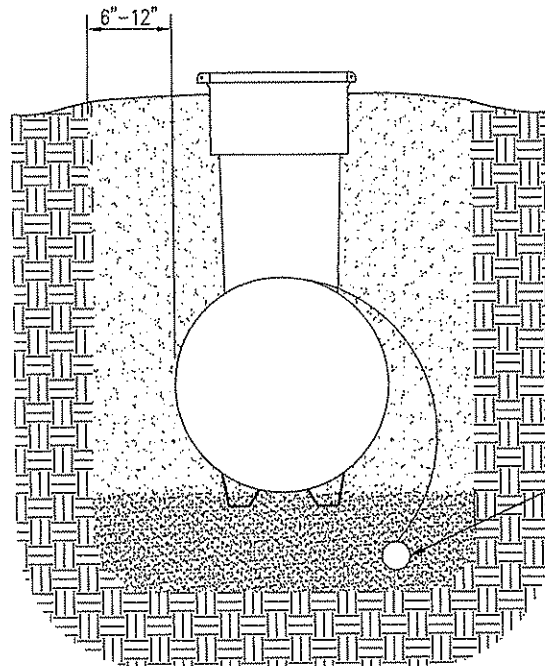

NOTE: OVER-ALL DEPTH OF BURIAL CALCULATED USING MAXIMUM 12" BOTTOM FILL COARSE SAND AND 6" MAXIMUM ABOVEGROUND SURFACE SLOPE, ORIGINATING AT RISER COLLAR.